

Stealth Watering System™


Direct Link

(FLT-DL)




Philadelphia Scientific®
industrial battery innovation

Installation: The Philadelphia Scientific® Stealth Watering System™ requires a water pressure of 3-45 psi. If your water supply does not meet these requirements, you will need to purchase an alternative to the Direct Link™




Do not fill the Direct Link directly from a faucet




The static water pressure may not exceed 80 PSI (25 bar).

Not Included

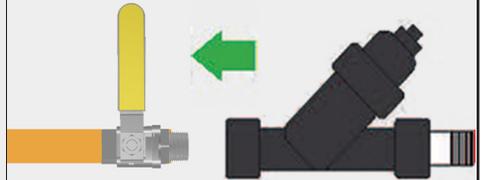


A Ball Valve with a 3/4" NPT male threaded fitting must be plumbed in to a pressurized water line (>3/4" or more in diameter).



Attach the black sediment filter to the

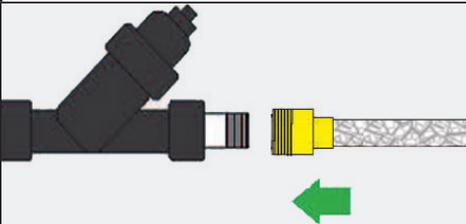

Attach the braided hose to the white male end of the sediment filter. Do not use more than 20 ft. of hose

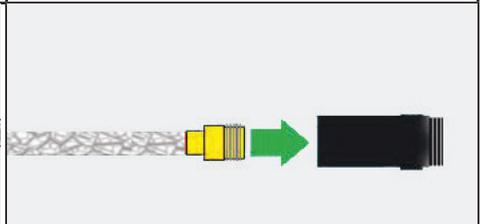



Attach the Pressure Regulator to the end of the braided hose.

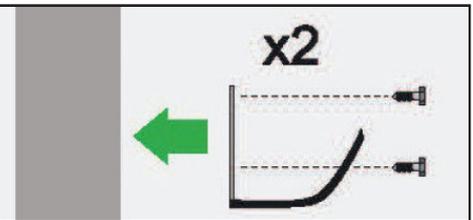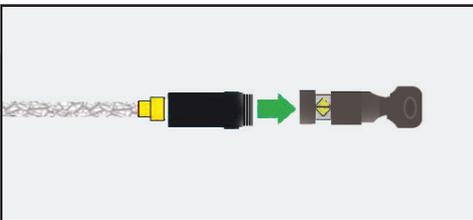

Attach the spinner output to the end of the Pressure Regulator


Mount included brackets on the wall.

Operation

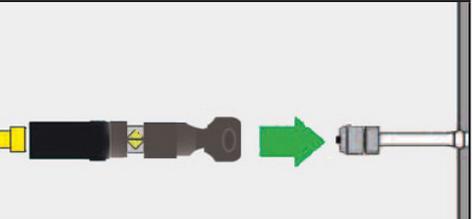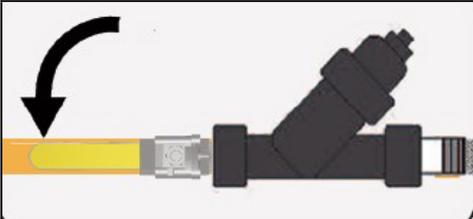



Turn water source on at the ball valve

Connect the Direct Link™ to the input assembly of the Stealth Watering System installed on the battery.

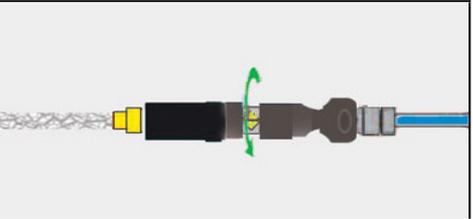

When the system is connected filling will begin automatically

Watch the spinner, when it stops spinning, the filling is completed.
The Spinner may not come to a complete stop, especially in larger systems. The battery is filled when the Spinner slows enough to clearly see the inner blades/vanes.

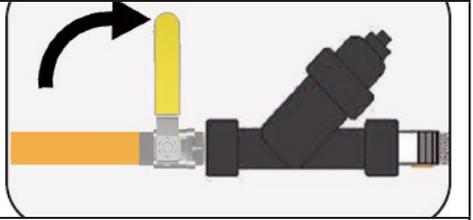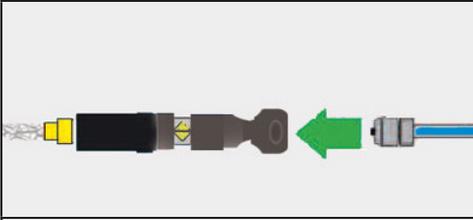

Disconnect the Quick-Connect to stop flow to the Stealth Watering System.

Move on to the next battery, when finished watering batteries turn the water off at the ball valve.

© 2023 Philadelphia Scientific LLC. All Rights Reserved.
Philadelphia Scientific and the PS logo are registered
trademarks of Philadelphia Scientific. Stealth Watering
System and Water Injector System are trademarks of Phila-
delphia Scientific LLC. E&O.E.



Philadelphia Scientific LLC 207 Progress Drive Montgomeryville, PA 18936
P: 215.616.0390 F: 215.616.0500 www.phlsci.com

PAK819
01/2023